


## CIRRUS ROCK HEATER- Installation Diagram for Separate Control


**NOTE:**  
Do not place the sensors too near to air ventilation (not under 1000mm) or not under 500mm from air ventilation, which is directed away from sensors.

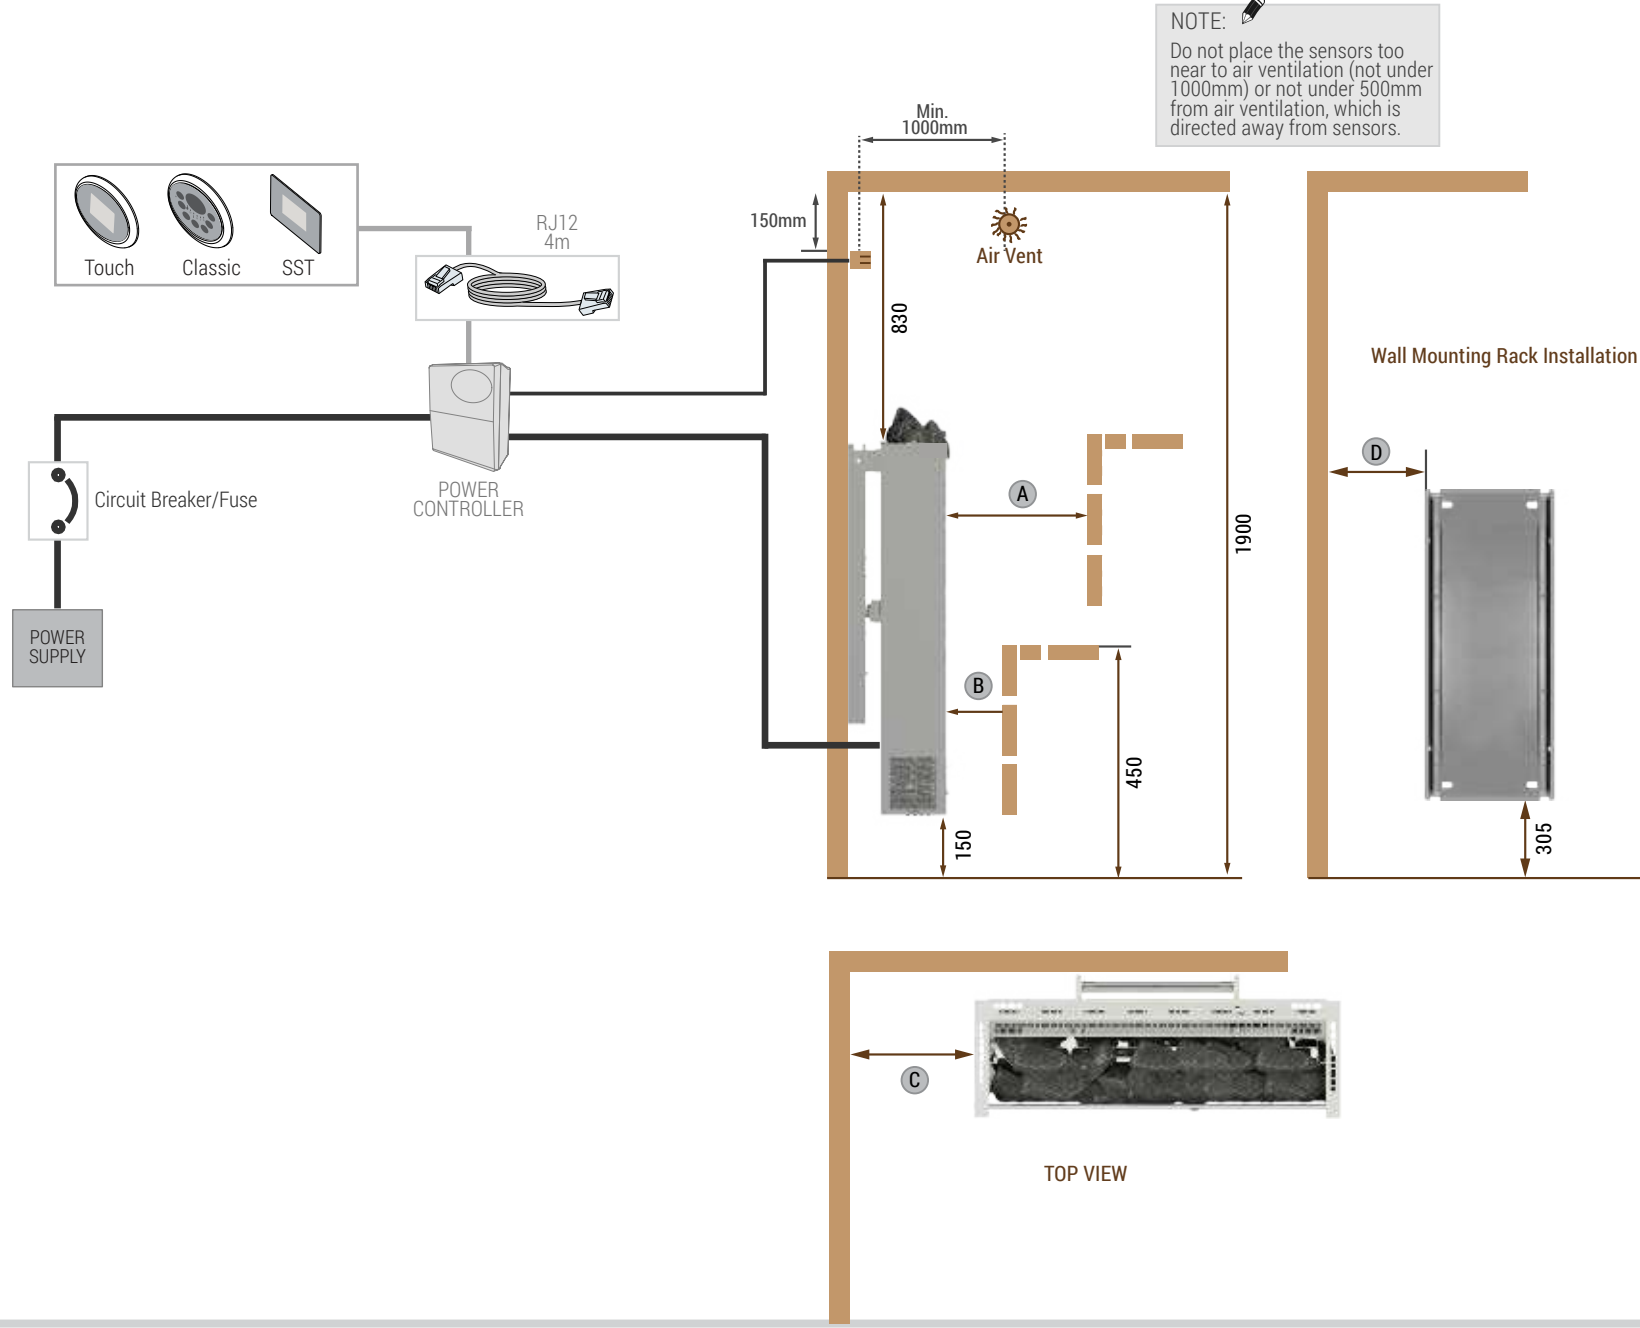

### Minimum Safety Distances

	A	B	C	D
CRR2-30NS	200	100	75	150
CRR2-40NS	200	100	75	150
CRR2-50NS	225	100	75	150
CRR2-60NS	250	100	100	175
CRR3-45NS	200	100	75	230
CRR3-60NS	250	100	100	255
CRR3-75NS	300	100	100	255
CRR3-90NS	350	100	125	280

## CIRRUS ROCK HEATER- Installation Diagram for Built-in Control

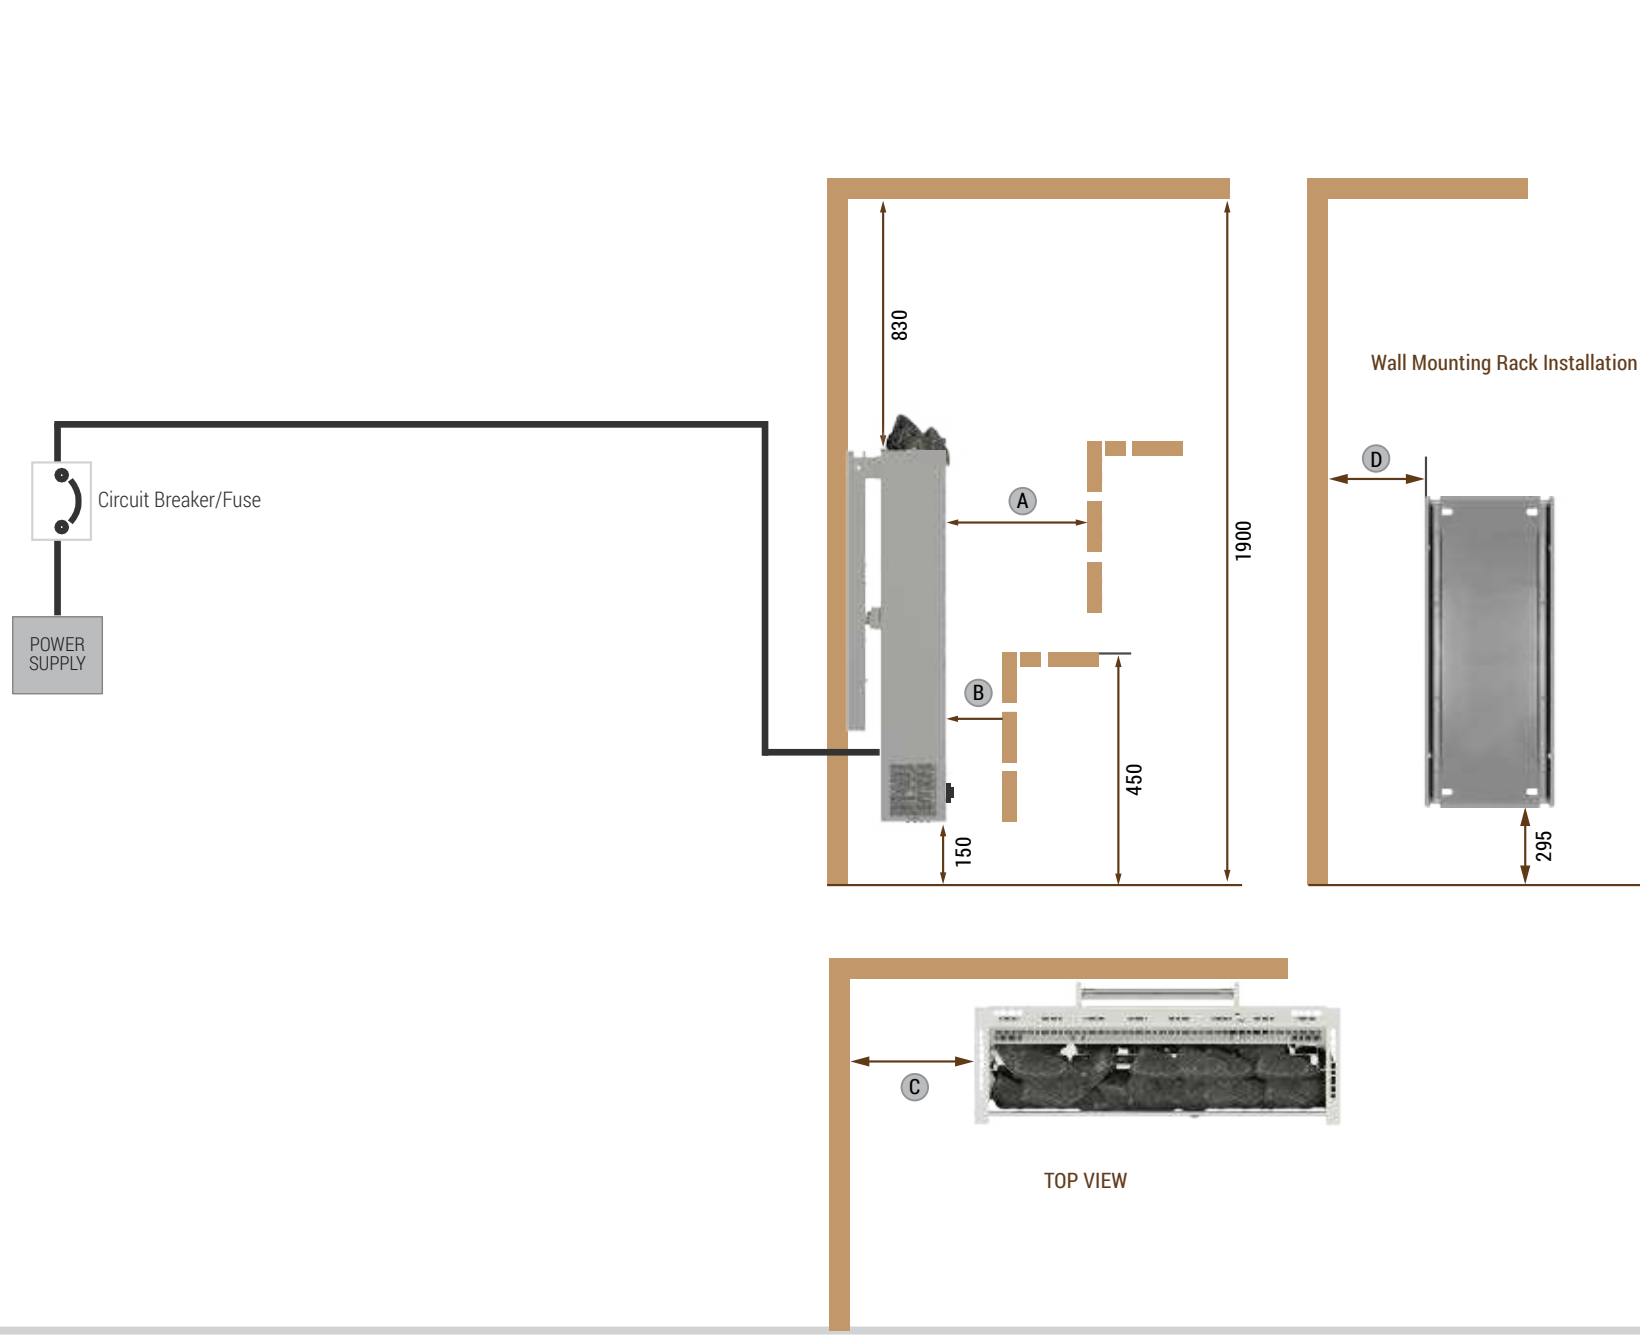

**Minimum Safety Distances**

	A	B	C	D
CRR2-30NB	200	100	75	150
CRR2-40NB	200	100	75	150
CRR2-50NB	225	100	75	150
CRR2-60NB	250	100	100	175
CRR3-45NB	200	100	75	230
CRR3-60NB	250	100	100	255
CRR3-75NB	300	100	100	255
CRR3-90NB	350	100	125	280