


NIMBUS HEATER- Installation Diagram for Separate Control (NS)



Minimum Safety Distances

	A	B	C	D
NIM-90N	110	50	1200	1900
NIM-105N	120	60	1200	1900
NIM-120N	130	70	1400	2100
NIM-150N	160	100	1400	2100
NIM-180N	160	100	1400	2100
NIM-180NV12	160	100	1400	2100
NIM-210NV12	160	100	1400	2100
NIM-240NV12	160	100	1400	2100

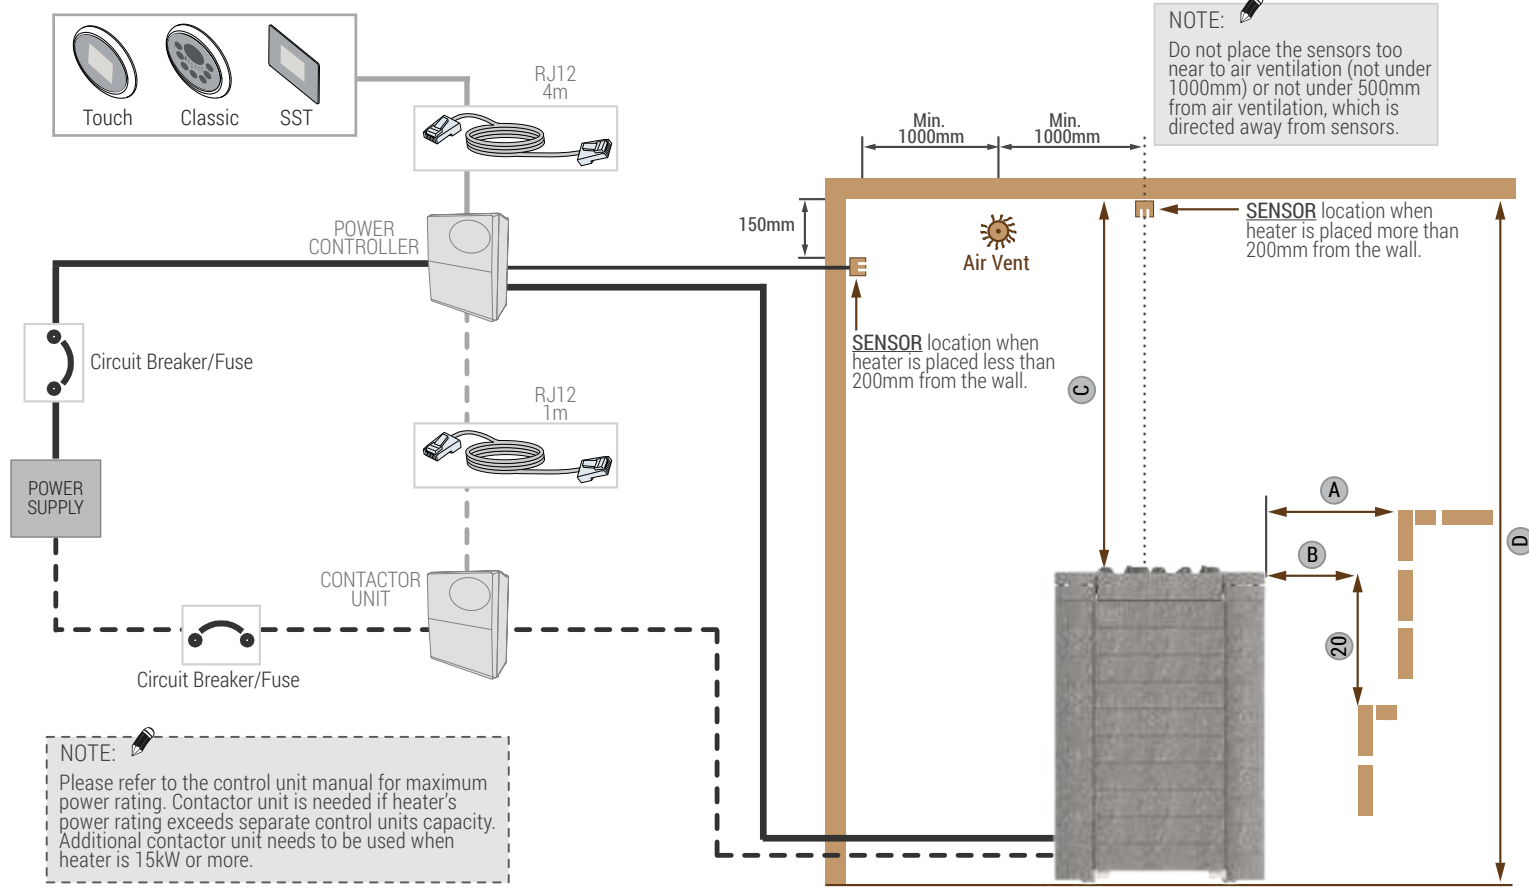